

*Published in Nucl. Instruments + Methods  
69:157-162, 1969*

**AFRRI TN68-6  
JUNE 1968**

**AFRRI  
TECHNICAL  
NOTE**

**FOR REFERENCE**

**Do Not Take From This Room**

**MEASUREMENT OF THE  
TRANSIENT CONTROL ROD MOTION  
AND ITS EFFECT ON THE  
AFRRI-TRIGA REACTOR PULSE**

**AFRRI TN68-6**

**ARMED FORCES RADIOBIOLOGY RESEARCH INSTITUTE  
Defense Atomic Support Agency  
Bethesda, Maryland**

**Distribution of this document is unlimited.**

This report has been approved for open publication by the Department of Defense


June 1968

MEASUREMENT OF THE TRANSIENT CONTROL ROD MOTION  
AND ITS EFFECT ON THE AFRRI-TRIGA REACTOR PULSE

B. E. LEONARD  
D. A. HUGHES



R. E. CARTER  
Chairman  
Physical Sciences Department

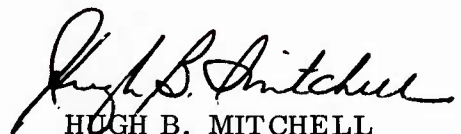

HUGH B. MITCHELL  
Colonel, USAF, MC  
Director

ARMED FORCES RADIOBIOLOGY RESEARCH INSTITUTE  
Defense Atomic Support Agency  
Bethesda, Maryland

### ACKNOWLEDGMENT

Appreciation is expressed to the Reactor Division staff for their assistance and to F. W. Bernhards, W. T. McPherson and R. J. Holthaus for the major effort on the design and fabrication of the transient rod motion system.

## TABLE OF CONTENTS

	Page
Foreword (Nontechnical summary) . . . . .	iii
Abstract . . . . .	iv
I. Introduction . . . . .	1
II. Description of Transient Rod Motion System . . . . .	2
III. Performance of the System . . . . .	6
IV. Results and Discussion of Transient Rod Motion Measurements . . . . .	7
V. Summary . . . . .	13
References . . . . .	15

## LIST OF FIGURES

	Page
Figure 1. Striped sleeve and connecting rod . . . . .	3
Figure 2. Frame and mounted components . . . . .	3
Figure 3. Photodiode sensing circuit . . . . .	4
Figure 4. Power supply circuit . . . . .	5
Figure 5. Block diagram -- transient rod displacement system . . . . .	5
Figure 6. Output traces of oscillograph . . . . .	6
Figure 7. Rod displacement and relative power for \$2.83 pulse . . . . .	8
Figure 8. \$2.83 and \$1.50 pulse . . . . .	9
Figure 9. Time to rod "full out" and to pulse peak . . . . .	10
Figure 10. Theoretical prompt jump region . . . . .	12
Figure 11. Experimental prompt jump region . . . . .	12

## TABLE

Table I. Effect of Variation of Air Solenoid Pressure on Pulse . . . . .	11
--	----

## FOREWORD

(Nontechnical summary)

The TRIGA nuclear reactor is presently the primary source of radiation for the radiobiology studies being conducted at the Armed Forces Radiobiology Research Institute. Much of the research is done with the pulsed radiation bursts from the reactor. Pneumatic ejection of a transient control rod from the fuel region of the reactor places the reactor in a highly supercritical state and results in an inherently safe self-controlled nuclear excursion which produces a large burst of neutrons and gamma rays. Reported here is the design of a system to study the finite travel time of this transient control rod and the measurement of the effect of the control rod motion on the behavior of the reactor.

With the pneumatic ejection pressure of 72 psi, the rod has been found to move outward with a nearly constant acceleration of 2.5 g's. It is also found that the rod momentum causes an initial depression of the shock absorbing anvil by about 1.1 centimeters above its final equilibrium position. For pulses on the order of prompt critical (\$1.00 reactivity insertion), major effects are produced in the magnitude and shape of the "prompt jump" region of the pulse. For reactivity insertions above \$2.80, a coupling between the outward travel time of the rod and the time of occurrence of the pulse peak has been observed. If lower air pressures are used for the ejection of the rod, the pulse peak can be caused to occur before the rod reaches the anvil. If the rod bounce produced by initial depression of the anvil occurs at nearly the time of the peak, distortions in the peak are observed with a corresponding effect on the total radiation produced in the burst.

## ABSTRACT

The design of a system for the measurement of the transient control rod motion of the AFRRI-TRIGA pulse reactor is presented. Data on the transient rod motion and its effect on the reactor pulse are presented and discussed. It is found that the finite travel time of the rod has an effect on the time of the pulse peak and the magnitude and shape of the pulses above \$3.00. For pulses on the order of \$1.00, the beginning of the power transient has been found to be sensitive to the transient rod bounce.



## I. INTRODUCTION

At the Armed Forces Radiobiology Research Institute (AFRRI), a large portion of the radiobiology research utilizes the TRIGA reactor as the radiation source. For this reason, it is desired that the nature and degree of reproducibility of the gamma ray and neutron fields from the reactor be known to high precision. A majority of the experiments is conducted with the pulsed radiation fields (bursts) that may be produced with the reactor. These bursts occur with a time duration on the order of milliseconds and produce drastically changing radiation intensities during this time. An extensive study of the AFRRI-TRIGA reactor radiation pulse has been undertaken to provide an understanding of how the properties of the radiation fields vary with time during and immediately following the pulse. This paper reports the design of a system to study the effect of the finite travel time of the transient control rod on the size and shape of the pulse of radiation.

The transient rod, which enables rapid insertion of large amounts of reactivity, is made of borated graphite in aluminum cladding. It is located on the vertical axis of the 20 percent enriched uranium, zirconium hydride and water moderated core which is suspended from a movable dolly into a water pool to a depth of approximately 15 feet. This water provides radiation shielding, neutron moderation, and cooling for the reactor core. The transient rod is driven out of the core pneumatically by a piston within a movable air cylinder located on the dolly. The amount of rod removed is predetermined by the positioning of the air cylinder and shock absorber (anvil) remotely from the control console. The shock absorber, at the upper end of the air cylinder, consists of a spring and hydraulic deceleration system. Such a system has

an inherent bounce characteristic when the piston reaches the top of the air cylinder. This has been indicated by high-speed photography.

To determine the transient rod effects on the pulse, a system was required to accurately correlate the displacement of the transient rod and the reactor power as a function of time during a pulse. The criteria for this system were that it be inexpensive to build, be capable of response times on the order of milliseconds, be durable enough to enable repetitive rod displacement measurements on a routine basis, provide immediate readout of data, and not affect the normal rod motion.

High-speed underwater movies, resistance wire systems and other methods were considered but were discarded for not satisfying one or more of the above criteria. The system finally developed was a simple light source--photodiode system.

## II. DESCRIPTION OF TRANSIENT ROD MOTION SYSTEM

The transient rod motion system developed indicates the transient rod displacement through its entire 15 inches of motion. A 1.0 inch i.d., 20 inches long stainless steel tube was machined to a wall thickness of 0.130 inch and polished. The tube was then painted with stripes of black acrylic paint 1 centimeter in width and spaced 1 centimeter apart. The connecting rod between the transient rod and the pneumatic piston on the core dolly was then disconnected and this striped stainless steel sleeve was fitted snugly onto the rod (Figure 1) and pinned into place. It was necessary to place the top of the sleeve at least 15 inches below the bottom of the pneumatic cylinder to permit this amount of the connecting rod to travel into the cylinder as the piston moves up. Thus the sleeve had to be placed under the surface of the water. Therefore, the photodiode sensor was also required to be under the water.

Figure 1. Striped sleeve and connecting rod

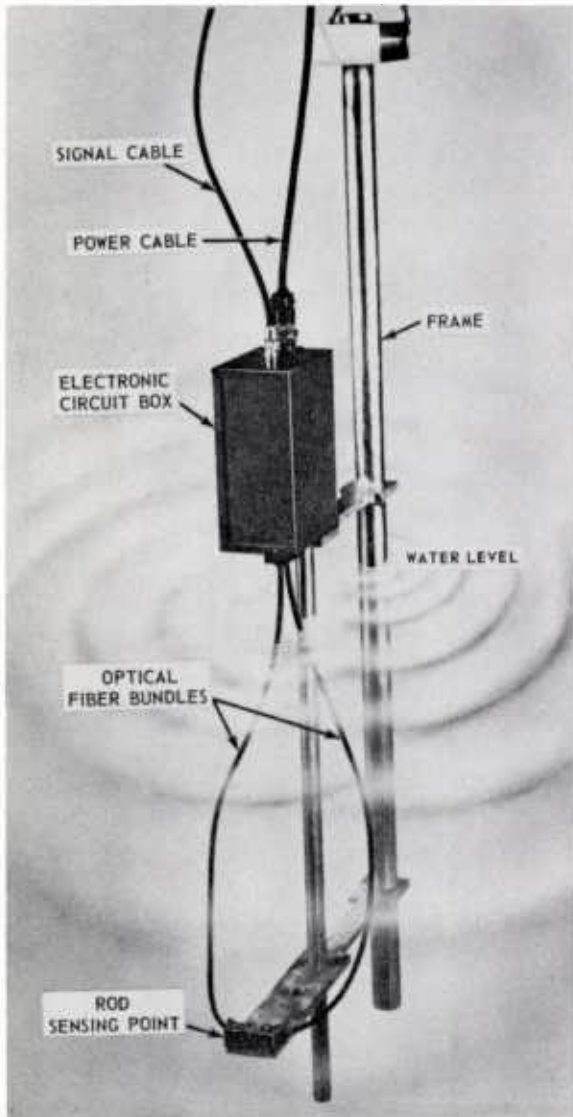
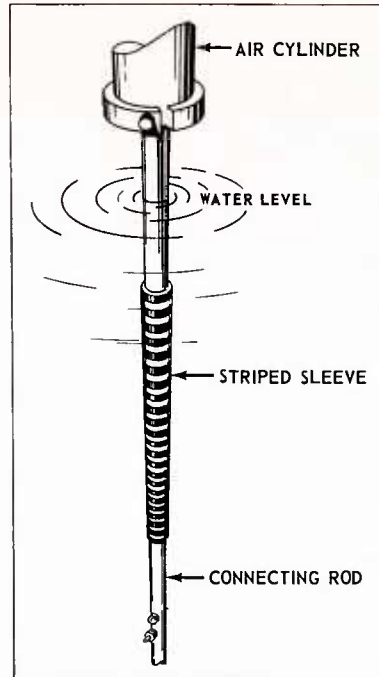


Figure 2. Frame and mounted components

To accomplish this, two 1/8-inch diameter optical fiber bundles were mounted on a frame with the electronic circuitry box mounted at the top (Figure 2). One optical fiber bundle provides a light path for the light source from the circuit box to the face of the striped sleeve and the other provides a light path for the reflected light from the sleeve to a photodiode sensor located in the circuit box. Figure 3 provides a schematic diagram of the sensing circuit. A Texas Instruments, Inc. type 1N2175, N-P-N diffused silicon

photo-duo-diode was selected for its fast rise time ( $\sim 2 \mu\text{sec}$ ) and high sensitivity. The preamplifier has a voltage amplification of 30 dB and response of  $\pm 1$  dB from 10 Hz to  $10^4$  Hz. The single stage amplifier serves to increase the rate of charge of the  $0.47 \mu\text{F}$  capacitor. The 2N1306 serves as a cathode follower to match the input requirement of a Model 1012, Minneapolis-Honeywell Visicorder Oscillograph.

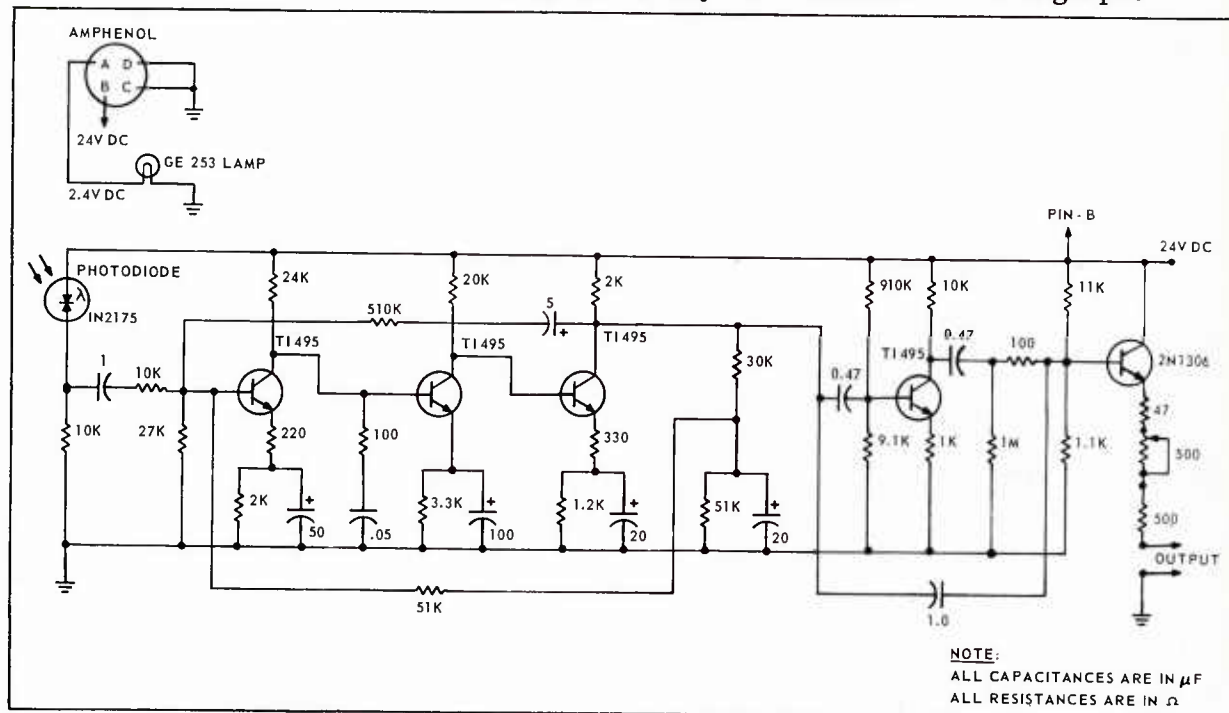


Figure 3. Photodiode sensing circuit

The circuit diagram of the power supply for the photodiode circuit and the G.E. 253 lamp light source is shown in Figure 4. The power supply provides 24 volts dc to the photodiode circuit and either 2.4 volts dc (for operation) or 6.3 volts ac (for alignment test) to the lamp.

An overall block diagram of the system is shown in Figure 5.

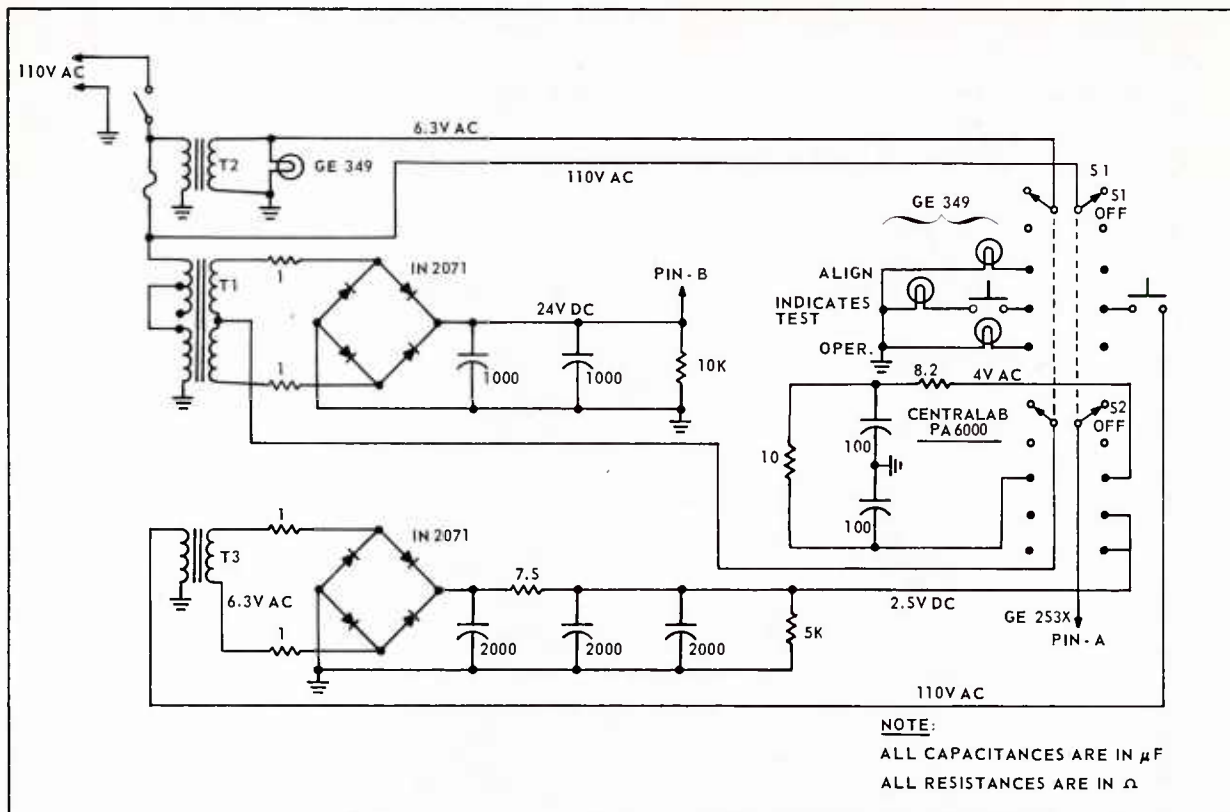


Figure 4. Power supply circuit

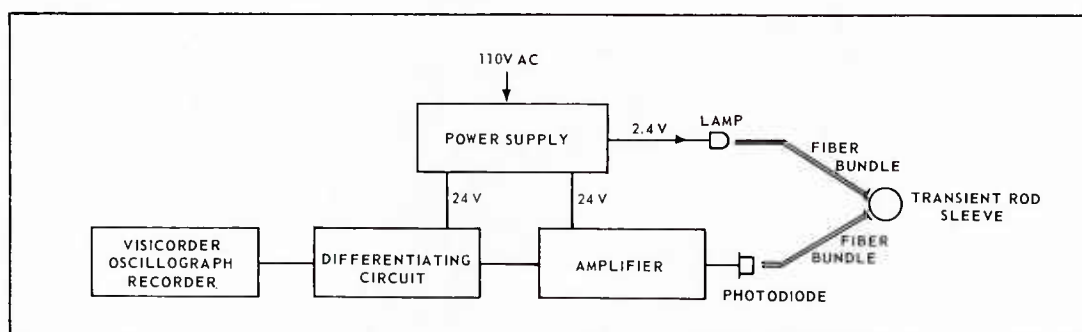


Figure 5. Block diagram -- transient rod displacement system

### III. PERFORMANCE OF THE SYSTEM

Figure 6 provides output traces on the Minneapolis-Honeywell Oscillograph for the motion of the transient rod as a function of time after the air solenoid is de-energized for a  $\$2.83$  reactivity insertion. The output is a series of positive and negative pulses resulting from differentiating the photodiode current as the polished and black striped stainless steel sleeve sections pass in front of the light source---photodiode face. Each positive pulse sharply denotes the point in time of passage of the sleeve from polished to black striped surface. Each negative pulse denotes the point in time of passage of the sleeve from black striped to polished surface. Thus each 1 centimeter displacement of the rod is recorded. The position of the rod as it

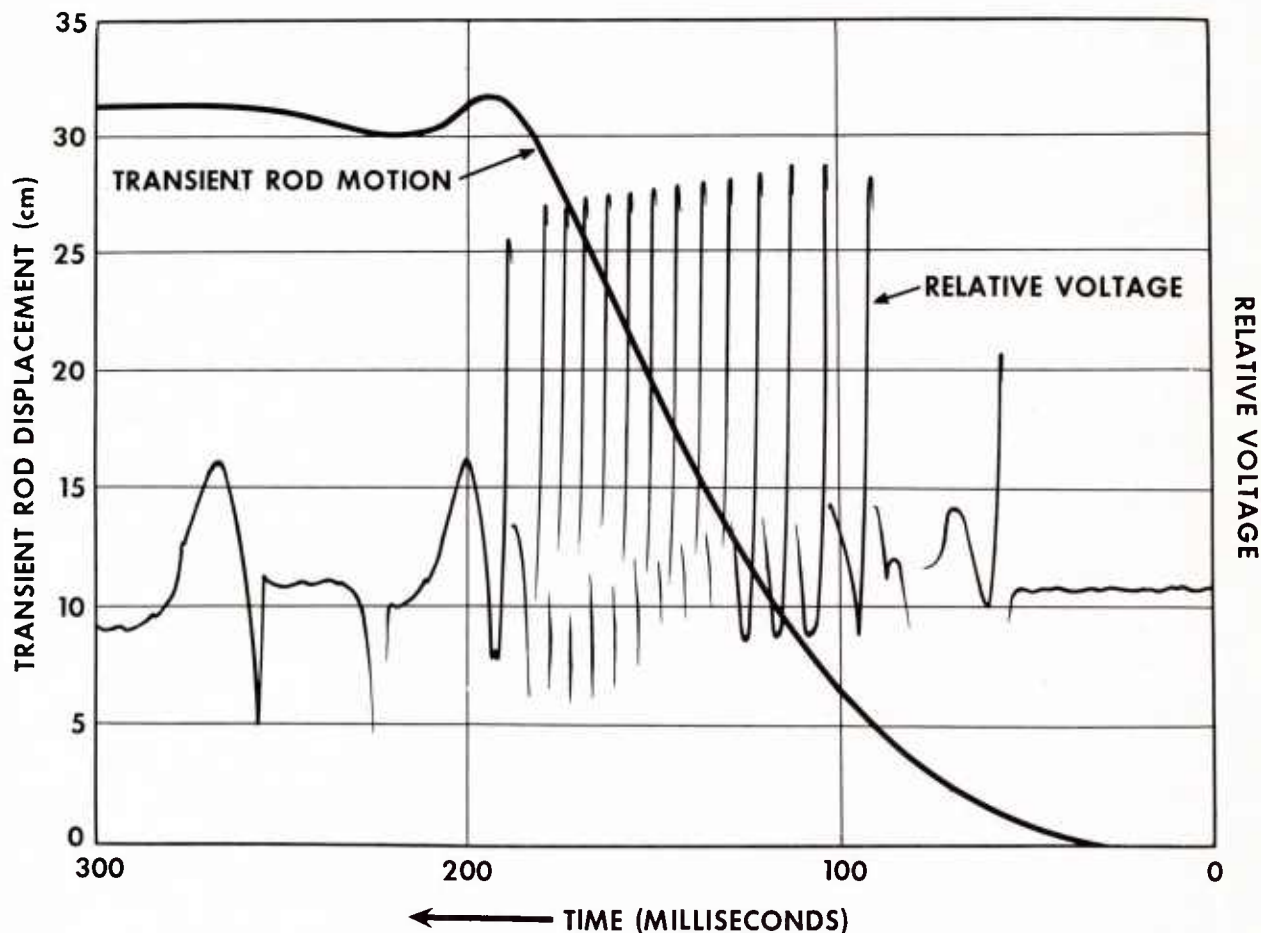


Figure 6. Output traces of oscillograph



passes each centimeter mark is known to within  $\pm 0.05$  centimeter. This precision is dependent upon factors such as amplifier gain, fiber bundle diameter, lamp intensity, etc.

Problems were experienced in positioning the rod sensing point (see Figure 2) to provide adequate light to the photodiode. However, when the sensing point was optimally positioned, at least a 50-milliampere peak output was observed and full scale deflection of the Visicorder trace was obtained using an M-1000 fluid damped subminiature galvanometer with the Visicorder.

#### IV. RESULTS AND DISCUSSION OF TRANSIENT ROD MOTION MEASUREMENTS

With the system described above, transient rod motion measurements have been made simultaneously with measurements of the TRIGA reactor power pulse. It has been found that the rod has a nearly constant acceleration for 72 psi air pressure of approximately  $2.4 \times 10^3 \text{ cm/s}^2$  (2.5 g's) until it makes contact with the upper shock absorber (anvil). It is found that the rod momentum then depresses the anvil about 1.1 centimeters above a final equilibrium position. The rod motion is, however, highly damped and only oscillates through slightly greater than one-half cycle before reaching its final position. This has been indicated by high-speed photography.

The characteristics of the reactor power transient during and immediately after the extraction of the rod have been examined to see what effect the finite travel time and bounce of the rod have on the pulse. For the larger pulses the reactor power exhibits little response to the transient rod other than from the "prompt jump" effect until the positive reactivity exceeds the prompt critical value of \$1.00. For times

much shorter than the shortest half-life fission product delayed neutron emitter, this is to be expected. Figure 7 shows the rod displacement and beginning of the power transient for a \$2.83 pulse as a function of time after the air solenoid valve is de-energized. The time at which \$1.00 of reactivity has been inserted is indicated.

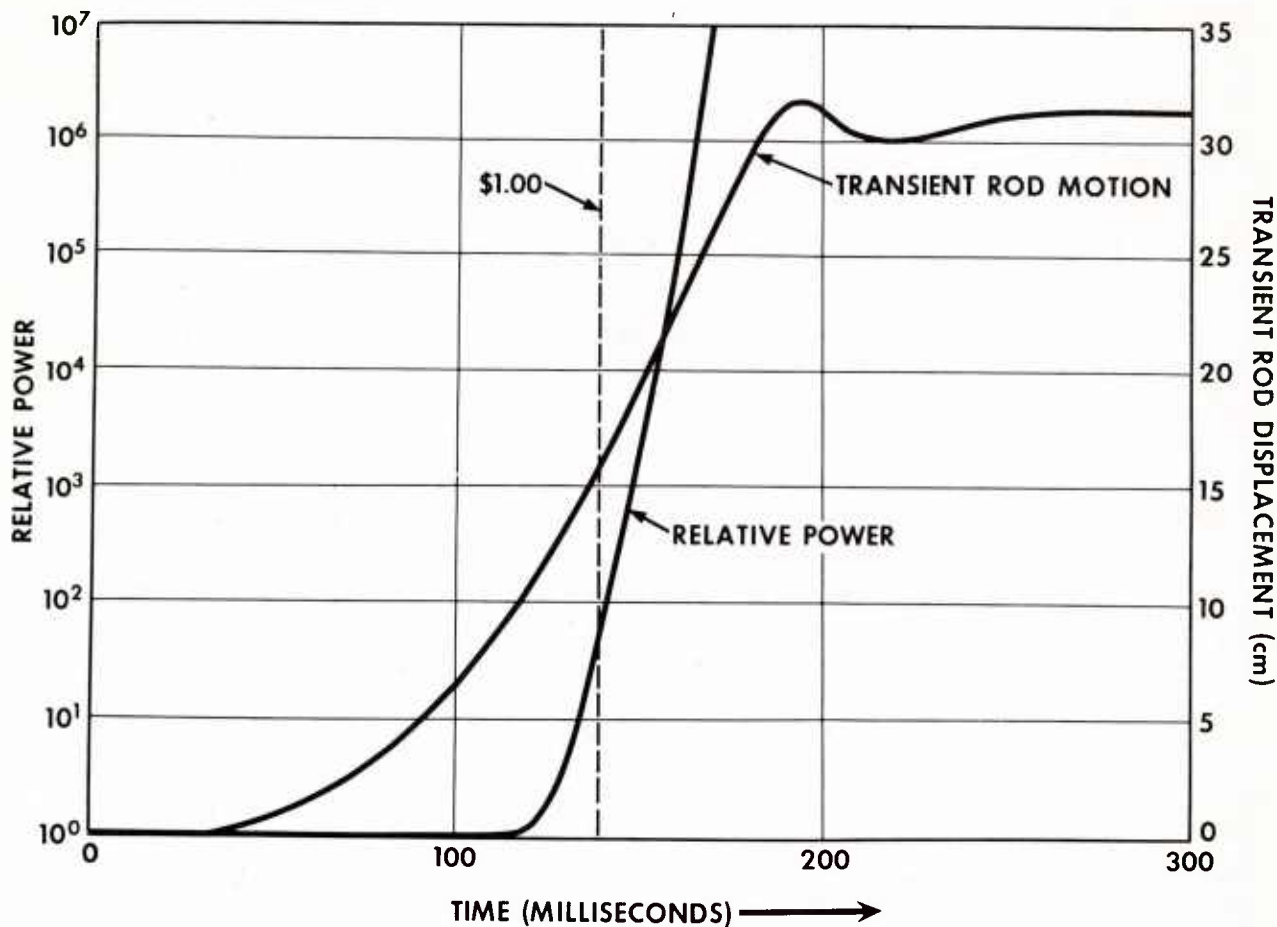


Figure 7. Rod displacement and relative power for \$2.83 pulse

The difference between the time required for the rod to achieve its "full out" position (taken to be the maximum point of travel with the anvil depressed) and the time for the peak of the reactor power excursion to occur decreases as the amount of reactivity is increased. This is due to two factors. It requires greater time for the



rod to travel further and, for the larger reactivity insertions, the rate of power rise is greater. Figure 8 provides plots of the reactor power excursion resulting from reactivity insertions of \$2.83 and \$1.50 and the time dependence of the transient rod displacement producing these power excursions. The peak of the pulse occurs simul-

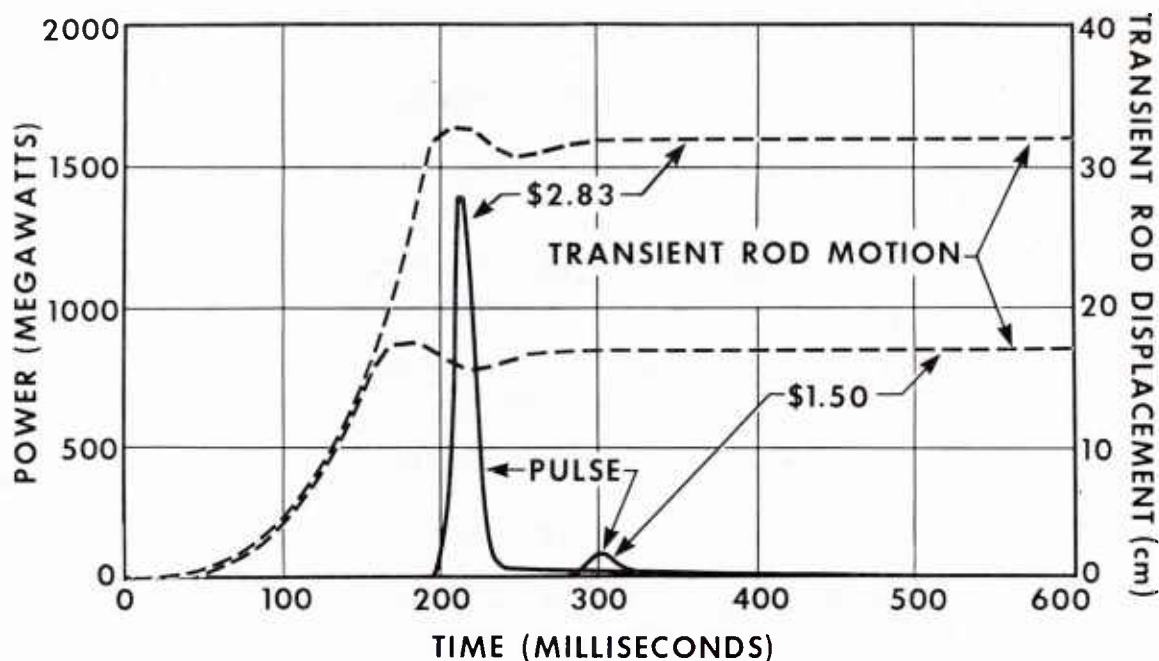


Figure 8. \$2.83 and \$1.50 pulse

taneously with the rod reaching its "full out" position for a \$2.83 pulse. It can be inferred from the results for the \$2.83 pulse that the time of the peak for larger pulses will be governed by the finite travel time of the transient rod. This is more clearly demonstrated in Figure 9 showing curves of time to rod "full out" and time to pulse peak. Thus, in the region of the peak, the pulse behaves as if an accelerated reactivity insertion was made for the large pulses and only for the smaller reactivity insertions does it behave as if a step insertion was made.

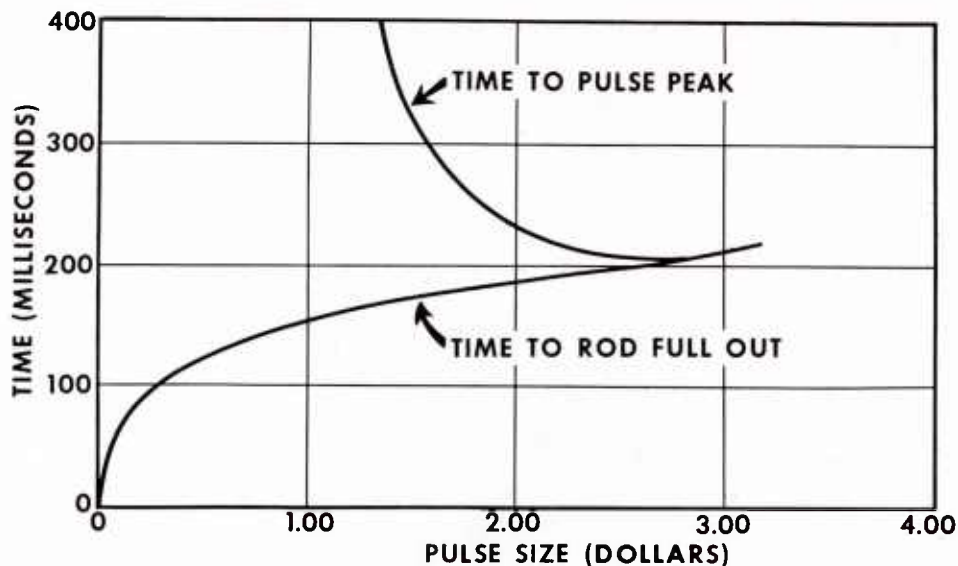


Figure 9. Time to rod "full out" and to pulse peak

The effect of the finite travel time and bounce of the rod at the termination of the travel has been studied by measurements in the reactivity range from \$2.83 to \$3.14. These rod motion effects have been accentuated by decreasing the air pressure to the piston and thus increasing the travel time of the rod. Table I provides data of rod travel time to bounce (the point of maximum inward motion after the rod has reached "full out"), time to pulse peak power and peak power in megawatts. Among the points to be noted is the relatively constant peak pulse size for all \$3.14 insertions except for that at 50 psi. In the 50 psi case, the rod bounce reduces the value of the peak power by about 6 percent. From these data it appears that the rod bounce only causes significant effects on the magnitude of the power peak when the bounce occurs near the time of the peak.

Table I. Effect of Variation of Air Solenoid  
Pressure on Pulse

Pressure (psi)	Pulse size (dollars)	Time to bounce* (milliseconds)	Time to peak * (milliseconds)	Peak power (megawatts)
76	2.83	128	129	1480
	3.00	131	133	1750
	3.14	129	139	1970
65	2.83	144	161	1528
	3.00	155	160	1812
	3.14	164	160	1968
60	2.83	150	166	1540
	3.00	164	170	1690
	3.14	176	170	1940
50	2.83	170	187	1500
	3.00	180	184	1760
	3.14	188	185	1848
45	2.83	182	208	1510
	3.00	199	209	1770
	3.14	216	210	1990

\* The times given here are based on  $t=0$  at the time the transient rod begins movement at the bottom of the piston. The time base for the figures is the time the air solenoid valve is de-energized. The difference is a function of pressure and is 80 milliseconds at 76 psi pressure.

It is also seen for low rod accelerations (45 and 50 psi) that the reactor power achieves a sufficiently high level that the pulse is turned over by temperature effects before the rod reaches "full out".

The unit of "dollar" is commonly used for reactivity since for values of reactivity below \$1.00, a reactor excursion must rely upon delayed neutrons which are emitted from the fission products fractions of a second to seconds after fission occurs. The effect of reactivity insertions in the region of \$1.00 is extremely critical to small uncertainties and perturbations in reactivity. This is especially true during the first few decades of the pulse due to the "prompt jump" effect caused by these delayed neutrons. Figure 10 shows the theoretical "prompt jump" region of the pulse for idealized "step function" reactivity insertions ranging from \$0.70 to \$1.40 for the

TRIGA reactor. Figure 11 provides experimental measurement of this time region for actual reactivity insertions of similar total magnitude.

Considerable difference in both the shape and the magnitude of the power in the "prompt jump" region is observed in Figures 10 and 11. This is primarily due to two factors. The power traces in Figure 11 coincide during the rod ejection period for all the insertions and this is because an accelerated reactivity insertion is being experienced rather than an instantaneous insertion. Secondly, the nonmonotonic behavior is


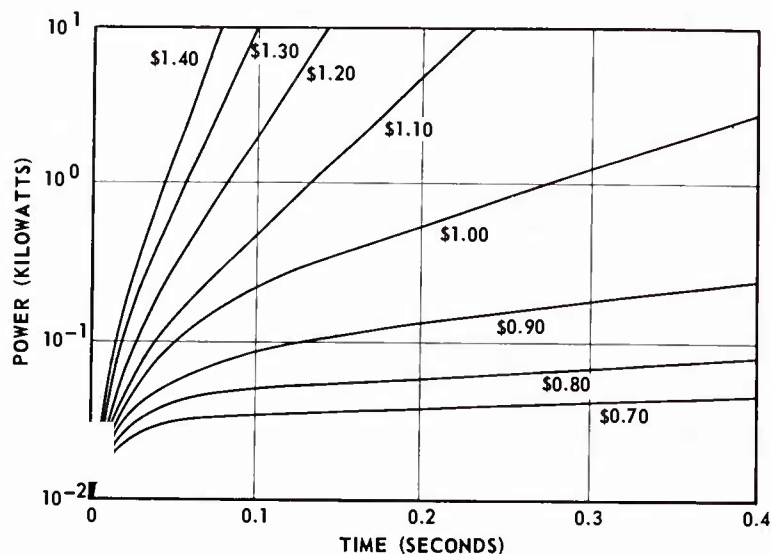


Figure 10. Theoretical prompt jump region

Figure 11. Experimental prompt jump region

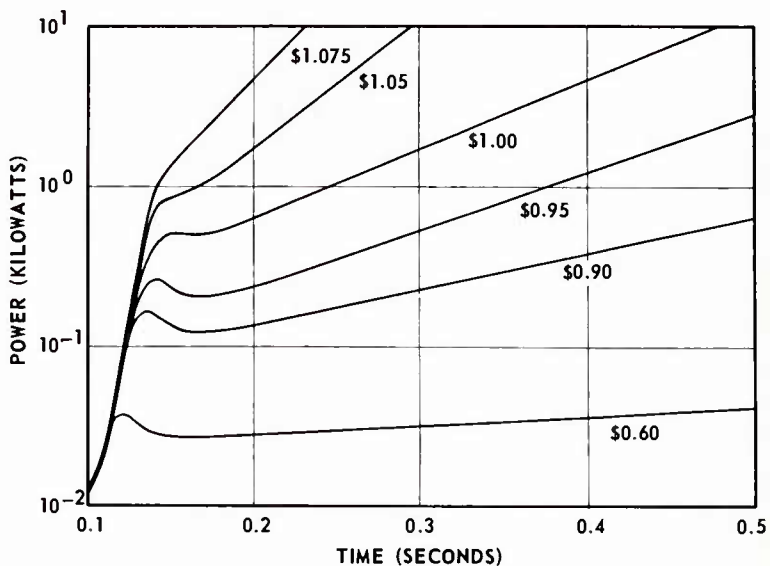

caused by the inward bounce of the rod and is due to the sensitivity of a supercritical nuclear reactor to small but sudden decreases in reactivity.<sup>1,2</sup>

For initial power levels on the order of watts, these two effects in the "prompt jump" region have negligible effect on the pulse peak for pulses on the order of \$1.00 since they occur far below the peak power levels which are on the order of megawatts.

The differences in the asymptotic regions of the power traces for the same reactivity insertions are attributed to dynamic reactivity effects reported earlier.<sup>1</sup>

## V. SUMMARY

The design of a system for the measurement of the transient control rod motion of the AFRRI-TRIGA reactor has been presented. Data on the transient rod motion and its effect on the reactor pulse are presented and discussed. It is shown that the finite travel time of the rod has an effect on the time of the pulse peak and possibly the magnitude for pulses above \$3.00. For pulses on the order of \$1.00, the rod bounce affects the beginning of the power transient in the "prompt jump" region. It is also found that the rod bounce has an effect on the magnitude of the peak of the pulse when the bounce occurs at the time of peak. Both observations point out the sensitivity to minor but sudden insertions of negative reactivity.

## REFERENCES

1. Leonard, B. E. Dynamic reactivity in nuclear reactors. Joint Automatic Control Conference of American Society of Mechanical Engineers, Philadelphia, Pennsylvania, June 1967. Preprint of Papers, New York, N.Y., Lewis Winner, p. 198, 1967.
2. Leonard, B. E. and Liner, R. T., Jr. Reactor laboratory experiments demonstrating delayed-neutron effects on an operating reactor. Trans. Amer. Nucl. Soc., 8:280-281, 1965.



## DISTRIBUTION LIST

### AIR FORCE

The Surgeon General, U. S. Department of the Air Force, Washington, D. C. 20333 (1)  
Executive Officer, Director of Professional Services, Office of the Surgeon General, Hq. USAF (AFMSPA) T-8, Washington, D. C. 20333 (1)  
Bioenvironmental Engineer, Hq. AFSC (SCBP), Andrews AFB, Washington, D. C. 20331 (1)  
USAFSAM (SMBR), ATTN: Chief, Radiobiology Branch, Brooks AFB, Texas 78235 (1)  
Chief, Weapons and Weapons Effects Division, Hq. RTD (RTTW), Bolling AFB, Washington, D. C. 20332 (1)  
Air Force Weapons Laboratory, ATTN: WLIL (1), ATTN: WLRB-2 (1), Kirtland AFB, New Mexico 87117 (2)  
Chief, Nuclear Medicine Department, P. O. Box 5088, USAF Hospital Wright-Patterson, Wright-Patterson AFB, Ohio 45433 (1)  
Commander, 6571st Aeromedical Research Laboratory, Holloman AFB, New Mexico 88330 (2)

### ARMY

The Surgeon General, U. S. Department of the Army, Washington, D. C. 20315 (1)  
Surgeon General, ATTN: MEDDH-N, U. S. Department of the Army, Washington, D. C. 20315 (1)  
Commandant, U. S. Army Chemical Center and School, ATTN: AJMCL-T, Fort McClellan, Alabama 36201 (1)  
USACDC CSSG, Doctrine Division, Fort Lee, Virginia 23801 (1)  
Commanding Officer, USACDC CBR Agency, Fort McClellan, Alabama 36201 (1)  
CG, USCONARC, ATTN: ATUTR-TNG (NBC), Fort Monroe, Virginia 23351 (1)  
Commanding General, U. S. Army Electronics Command, ATTN: AMSEL-RD-MAT, Fort Monmouth, New Jersey 07703 (1)  
Office of the Chief of Engineers, ATTN: Chief, Library Branch, STINFO Division, U. S. Department of the Army, Washington, D. C. 20315 (1)  
Commanding Officer, U. S. Army Engineer Research and Development Laboratories, ATTN: Technical Document Center, Fort Belvoir, Virginia 22060 (1)  
Commanding Officer, Harry Diamond Laboratories, ATTN: Nuclear Vulnerability Branch, Washington, D. C. 20438 (1)  
Nuclear Branch AMCRD-DN-RE, U. S. Army Materiel Command, Washington, D. C. 20315 (1)  
Commanding Officer, U. S. Army Medical Research Laboratory, Fort Knox, Kentucky 40121 (1)  
Commanding Officer, USA Nuclear Medical Research Detachment, Europe, APO New York, N. Y. 09180 (2)  
Army Research Office, ATTN: Chief, Scientific Analysis Branch, Life Sciences Division, 3045 Columbia Pike, Arlington, Virginia 22204 (1)  
Commanding General, U. S. Army Tank-Automotive Center, ATTN: SMOTA-RCSN, Warren, Michigan 48090 (1)  
Commanding Officer, U. S. Army Nuclear Defense Laboratory, ATTN: Technical Library, Edgewood Arsenal, Maryland 21010 (1)  
Division of Nuclear Medicine, Walter Reed Army Institute of Research, Walter Reed Army Medical Center, Washington, D. C. 20012 (5)  
Commanding Officer, U. S. Army Environmental Hygiene Agency, ATTN: USAEHA-RP, Edgewood Arsenal, Maryland 21010 (1)  
Commandant, U. S. Army Medical Field Service School, ATTN: MEDEW - ZNW, Fort Sam Houston, Texas 78234 (1)  
W. Giesler, Harry Diamond Laboratories, Washington, D. C. 20438 (1)

### NAVY

Chief, Bureau of Medicine and Surgery, U. S. Navy Department, Washington, D. C. 20390 (1)  
Chief, Bureau of Medicine and Surgery, ATTN: Code 71, U. S. Navy Department, Washington, D. C. 20390 (1)  
Commanding Officer and Director (Code L31), U. S. Naval Civil Engineering Laboratory, Port Hueneme, California 93041 (1)  
Commanding Officer and Director (222A), U. S. Naval Radiological Defense Laboratory, San Francisco, California 94135 (2)  
Head, Biological and Medical Sciences Division, U. S. Naval Radiological Defense Laboratory, San Francisco, California 94135, ATTN: Dr. E. L. Alpen (1)  
Commanding Officer, Naval Aerospace Medical Institute, Naval Aviation Medical Center, ATTN: Director of Research, Pensacola, Florida 32512 (3)  
Commanding Officer, U. S. Naval Weapons Evaluation Facility (Code WE), Kirtland Air Force Base, Albuquerque, New Mexico 87117 (1)  
Commanding Officer, Nuclear Weapons Training Center, Atlantic, Nuclear Warfare Department, Norfolk, Virginia 23511 (1)

### D. O. D.

Director, Defense Atomic Support Agency, Washington, D. C. 20305 (1)  
Director, Defense Atomic Support Agency, ATTN: DDST, Washington, D. C. 20305 (1)  
Director, Defense Atomic Support Agency, ATTN: Chief, Medical Directorate, Washington, D. C. 20305 (4)  
Director, Defense Atomic Support Agency, ATTN: Chief, Radiation Directorate, Washington, D. C. 20305 (1)  
Director, Defense Atomic Support Agency, ATTN: Technical Library, Washington, D. C. 20305 (1)  
Chief, Livermore Division, FC DASA, Lawrence Radiation Laboratory, Livermore, California 94550 (1)  
Commander, Headquarters Field Command, Defense Atomic Support Agency, ATTN: FCTG8, Sandia Base,  
Albuquerque, New Mexico 87115 (1)  
Director, Armed Forces Institute of Pathology, Washington, D. C. 20305 (1)  
Administrator, Defense Documentation Center, Cameron Station, Bldg. 5, Alexandria, Virginia 22314 (20)

### OTHER GOVERNMENT

U. S. Atomic Energy Commission, Division of Technical Information, P. O. Box 62, Oak Ridge, Tennessee 37831 (10)  
U. S. Atomic Energy Commission, Headquarters Library, Reports Section, Mail Station G-17, Washington, D. C. 20545 (1)  
U. S. Atomic Energy Commission, Division of Biology and Medicine, Washington, D. C. 20545 (1)  
U. S. Atomic Energy Commission, Division of Isotopes Development, ATTN: Mr. John C. Dempsey, Washington, D. C. 20545 (1)  
U. S. Atomic Energy Commission, Bethesda Technical Library, 4915 St. Elmo Avenue, Bethesda, Maryland 20014 (1)  
U. S. Department of Commerce, Environmental Science Services Administration, ATTN: Library, Boulder Laboratories, Boulder, Colorado 80302 (1)  
National Bureau of Standards Library, ATTN: Sarah Ann Jones, Chief Librarian, Washington, D. C. 20234 (1)  
National Bureau of Standards, ATTN: Chief, Radiation Physics Division, Washington, D. C. 20234 (5)  
U. S. Public Health Service, Deputy Chief, Division of Radiological Health, Washington, D. C. 20201 (1)  
U. S. Public Health Service, Radiological Health Laboratory, ATTN: Library, 1901 Chapman Avenue, Rockville, Maryland 20852 (1)  
U. S. Public Health Service, Northeastern Radiological Health Laboratory, 109 Holton Street, Winchester, Massachusetts 01890 (1)  
U. S. Public Health Service, Southwestern Radiological Health Laboratory, P. O. Box 684, Las Vegas, Nevada 89101 (1)  
Dr. C. Muelhouse, Radiation Research Center, National Bureau of Standards, Washington, D. C. 20234 (1)

### OTHER

Argonne National Laboratory, Library Services Department, Report Section Bldg. 203, RM-CE-125, 9700 South Cass Avenue, Argonne, Illinois 60440 (1)  
Boeing Company Aerospace Library, ATTN: 8K-38 Ruth E. Peerenboom, P. O. Box 3999, Seattle, Washington, 98124 (2)  
Brookhaven National Laboratory, Information Division, ATTN: Research Library, Upton, Long Island, New York 11973 (2)  
S. C. Bushong, Department of Radiology, Baylor University College of Medicine, Houston, Texas 77024 (1)  
Director, Radiobiology Laboratory, University of California, Davis, California 95616 (1)  
University of California, Lawrence Radiation Laboratory, Technical Information Division Library L-3, P. O. Box 808, Livermore, California 94551 (2)  
E. I. du Pont de Nemours & Company, Savannah River Laboratory, Technical Information Service 773-A, Aiken, South Carolina 29801 (1)  
General Dynamics/Fort Worth, ATTN: Librarian, P. O. Box 748, Fort Worth, Texas 76101 (1)  
Dr. Arnold Feldman, Consultant in Biophysics, Mayo Clinic, Rochester, Minnesota 55901 (1)  
Hazelton Nuclear Science Corporation, ATTN: Library, 4062 Fabian Way, Palo Alto, California 94303 (1)  
Holmes & Narver, Inc., Nuclear Division Library, 828 South Figueroa Street, Los Angeles, California 90017 (1)  
IIT Research Institute, ATTN: Document Library, 10 West 35th Street, Chicago, Illinois 60616 (1)  
Prof. Merril Eisenbud, New York University, Tuxedo, New York 10987 (1)  
Library, Laboratory of Nuclear Medicine and Radiation Biology, University of California, Los Angeles, 900 Veteran Avenue, Los Angeles, California 90024 (1)  
Los Alamos Scientific Laboratory, ATTN: Report Librarian, P. O. Box 1663, Los Alamos, New Mexico 87544 (1)  
Director, Nuclear Science Center, Louisiana State University, Baton Rouge, Louisiana 70803 (2)  
Lovelace Foundation for Medical Education & Research, Document Library, 5200 Gibson Boulevard, S. E., Albuquerque, New Mexico 87108 (1)



#### OTHER (continued)

- Dr. J. I. Marcum, Rand Corporation, 1700 Main Street, Santa Monica, California 90401 (1)  
M. I. T. Libraries, Technical Reports, Room 14 E-210, Massachusetts Institute of Technology, Cambridge, Massachusetts 02139 (1)  
Dr. Charles W. Mays, Physics Group Leader, Radiobiology Division, University of Utah, Salt Lake City, Utah 84112 (1)  
Dr. B. D. Newsom, Senior Staff Scientist, Life Sciences, Research, Development & Engineering, General Dynamics/Convair Division, P. O. Box 1128, San Diego, California 92112 (1)  
President, Nuclear Technology Corporation, 116 Main Street, White Plains, New York 10601 (1)  
Ohio State University, Nuclear Reactor Laboratory, 1298 Kinnear Road, Columbus, Ohio 43212 (1)  
Dr. Alan Orvis, Consultant in Biophysics, Mayo Clinic, Rochester, Minnesota 55901 (1)  
Nuclear Engineering Library, Purdue University, Lafayette, Indiana 47907 (1)  
Radiation Effects Information Center, Battelle Memorial Institute, 505 King Avenue, Columbus, Ohio 43201 (1)  
Dr. S. M. Reichard, Director, Division of Radiobiology, Medical College of Georgia, Augusta, Georgia 30902 (1)  
University of Rochester, Atomic Energy Project Library, P. O. Box 287, Station 3, Rochester, New York 14620 (1)  
Dr. H. H. Rossi, 630 West 168th Street, New York, N. Y. 10032 (1)  
Sandia Corporation Library, P. O. Box 5800, Albuquerque, New Mexico 87115 (1)  
Sandia Corporation, Livermore Laboratory, ATTN: Technical Library, P. O. Box 969, Livermore, California 94550 (1)  
Scope Publications, Franklin Station, P. O. Box 7407, Washington, D. C. 20004 (1)  
University of Southern California, Nuclear Physics Laboratory, University Park, Los Angeles, California 90007 (1)  
Radiation Biology Laboratory, Texas Engineering Experiment Station, Texas A. & M. University, College Station, Texas 77840 (2)  
Western Reserve University, Department of Radiology, Division of Radiation Biology, Cleveland, Ohio 44106 (1)  
Director, Electron Accelerator Laboratory, Yale University, New Haven, Connecticut 06520 (1)  
Texas Nuclear Corporation, ATTN: Director of Research, Box 9267 Allandale Station, Austin, Texas 78756 (1)  
Gulf General Atomic Incorporated, ATTN: Library, P. O. Box 608, San Diego, California 92112 (1)  
Gulf General Atomic Incorporated, ATTN: A. Graf, P. O. Box 608, San Diego, California 92112 (1)  
Professor M. E. Wyman, Nuclear Engineering Program, University of Illinois, Urbana, Illinois 61801 (1)  
Professor E. Jordan, Department of Nuclear Engineering, Catholic University, Washington, D. C. 20017 (1)  
Professor R. Duffey, Department of Nuclear Engineering, University of Maryland, College Park, Maryland 20740 (1)  
Cornell University, Department of Nuclear Engineering, Ithaca, New York 14850 (1)  
New York University, Department of Nuclear Engineering, New York, N. Y. 10019 (1)  
University of California, Department of Nuclear Engineering, Berkeley, California 94720 (1)  
Texas A & M College, Department of Nuclear Engineering, College Station, Texas 77843 (1)  
University of Arizona, Department of Nuclear Engineering, Tucson, Arizona 85721 (1)  
Pennsylvania State University, Department of Nuclear Engineering, University Park, Pennsylvania 16802 (1)  
Dr. R. L. Murray, Department of Nuclear Engineering, North Carolina State University, Raleigh, North Carolina 27607 (1)

#### FOREIGN

- Library, Atomic Energy of Canada Ltd., P. O. Box 905, Toronto 18, Ontario, Canada (1)  
Dr. G. W. Barendsen, Radiobiological Institute TNO, Rijswijk, Netherlands (1)  
European Atomic Energy Community, C.E.E.A., Library, 51 rue Belliard, Brussels 4, Belgium (1)  
International Atomic Energy Agency, Kaerntnerring 11, Vienna I. 1010, Austria (1)  
Dr. L. G. Lajtha, Paterson Laboratories, Christie Hospital and Holt Radium Inst., Manchester, England (1)  
Dr. L. F. Lamerton, Biophysics Department, Institute of Cancer Research, Surrey Branch, Belmont, Sutton, Surrey, England (1)  
Dr. Helmut Mitschrich, Academie des Sanitaets-und Gesundheits, Weseus BW, Spezialstab ATV, 8 Muenchen, Schwere-Reiterstr. 4, Germany (2)  
Puerto Rico Nuclear Center, ATTN: Reading Room, College Station, Mayaguez, Puerto Rico 00708 (2)  
University of Saskatchewan, ATTN: Director, Accelerator Laboratory, Saskatoon, Saskatchewan, Canada (1)  
Director, Science Abstracts, Institution of Electrical Engineers, Savoy Place, London WC2, England (1)  
Directorate of Medical and Health Services, FAF (Federal Armed Forces), Bonn, Ermekeilstr. 27, West Germany (1)  
Prof. Dr. H. Langendorff, Direktor des Radiologischen Instituts der Universitat, 78 Freiburg im Breisgau, Albertstrasse 23, Germany (1)  
Prof. Dr. F. Wachsmann, Gesellschaft fur Strahlenforschung m.b.H., 8042 Neuherberg bei Muenchen, Institut fur Strahlenschutz, Ingolstadter Landstrasse 1, Muenchen, Germany (1)

FOREIGN (continued)

Joachim Emde, Oberst und Leiter Spezialstab ATV, ABC- und Selbstschuttschule, 8972 Sonthofen 2 (Allgau),  
Berghoferstrasse 17, West Germany (1)

Abteilung fur Strahlenbiologie im Institut fur Biophysik der Universitat Bonn, 53 Bonn-Venusberg, Annaberger  
Weg 15, Federal Republic of Germany (2)

Dr. G. E. Adams, Research Unit in Radiobiology, Mount Vernon Hospital, Northwood, Middlesex, England (1)

UNCLASSIFIED

Security Classification

## DOCUMENT CONTROL DATA - R&amp;D

(Security classification of title, body of abstract and indexing annotation must be entered when the overall report is classified)

1. ORIGINATING ACTIVITY (Corporate author) Armed Forces Radiobiology Research Institute Defense Atomic Support Agency Bethesda, Maryland 20014		2a. REPORT SECURITY CLASSIFICATION UNCLASSIFIED	
		2b. GROUP N/A	
3. REPORT TITLE MEASUREMENT OF THE TRANSIENT CONTROL ROD MOTION AND ITS EFFECT ON THE AFRRI-TRIGA REACTOR PULSE			
4. DESCRIPTIVE NOTES (Type of report and inclusive dates)			
5. AUTHOR(S) (Last name, first name, initial) Leonard, B. E. and Hughes, D. A.			
6. REPORT DATE June 1968		7a. TOTAL NO. OF PAGES 22	7b. NO. OF REFS 2
8a. CONTRACT OR GRANT NO.		9a. ORIGINATOR'S REPORT NUMBER(S) AFRRI TN68-6	
b. PROJECT NO.			
c.		9b. OTHER REPORT NO(S) (Any other numbers that may be assigned this report)	
d.			
10. AVAILABILITY/LIMITATION NOTICES Distribution of this document is unlimited.			
11. SUPPLEMENTARY NOTES		12. SPONSORING MILITARY ACTIVITY Defense Atomic Support Agency Washington, D. C. 20305	
13. ABSTRACT The design of a system for the measurement of the transient control rod motion of the AFRRI-TRIGA pulse reactor is presented. Data on the transient rod motion and its effect on the reactor pulse are presented and discussed. It is found that the finite travel time of the rod has an effect on the time of the pulse peak and the magnitude and shape of the pulses above \$3.00. For pulses on the order of \$1.00, the beginning of the power transient has been found to be sensitive to the transient rod bounce.			

14. KEY WORDS	LINK A		LINK B		LINK C	
	ROLE	WT	ROLE	WT	ROLE	WT
TRIGA pulse transient rod effect						

**INSTRUCTIONS**

1. **ORIGINATING ACTIVITY:** Enter the name and address of the contractor, subcontractor, grantee, Department of Defense activity or other organization (*corporate author*) issuing the report.

2a. **REPORT SECURITY CLASSIFICATION:** Enter the overall security classification of the report. Indicate whether "Restricted Data" is included. Marking is to be in accordance with appropriate security regulations.

2b. **GROUP:** Automatic downgrading is specified in DoD Directive 5200.10 and Armed Forces Industrial Manual. Enter the group number. Also, when applicable, show that optional markings have been used for Group 3 and Group 4 as authorized.

3. **REPORT TITLE:** Enter the complete report title in all capital letters. Titles in all cases should be unclassified. If a meaningful title cannot be selected without classification, show title classification in all capitals in parenthesis immediately following the title.

4. **DESCRIPTIVE NOTES:** If appropriate, enter the type of report, e.g., interim, progress, summary, annual, or final. Give the inclusive dates when a specific reporting period is covered.

5. **AUTHOR(S):** Enter the name(s) of author(s) as shown on or in the report. Enter last name, first name, middle initial. If military, show rank and branch of service. The name of the principal author is an absolute minimum requirement.

6. **REPORT DATE:** Enter the date of the report as day, month, year, or month, year. If more than one date appears on the report, use date of publication.

7a. **TOTAL NUMBER OF PAGES:** The total page count should follow normal pagination procedures, i.e., enter the number of pages containing information.

7b. **NUMBER OF REFERENCES:** Enter the total number of references cited in the report.

8a. **CONTRACT OR GRANT NUMBER:** If appropriate, enter the applicable number of the contract or grant under which the report was written.

8b, 8c, & 8d. **PROJECT NUMBER:** Enter the appropriate military department identification, such as project number, subproject number, system numbers, task number, etc.

9a. **ORIGINATOR'S REPORT NUMBER(S):** Enter the official report number by which the document will be identified and controlled by the originating activity. This number must be unique to this report.

9b. **OTHER REPORT NUMBER(S):** If the report has been assigned any other report numbers (*either by the originator or by the sponsor*), also enter this number(s).

10. **AVAILABILITY/LIMITATION NOTICES:** Enter any limitations on further dissemination of the report, other than those imposed by security classification, using standard statements such as:

- (1) "Qualified requesters may obtain copies of this report from DDC."
- (2) "Foreign announcement and dissemination of this report by DDC is not authorized."
- (3) "U. S. Government agencies may obtain copies of this report directly from DDC. Other qualified DDC users shall request through \_\_\_\_\_."
- (4) "U. S. military agencies may obtain copies of this report directly from DDC. Other qualified users shall request through \_\_\_\_\_."
- (5) "All distribution of this report is controlled. Qualified DDC users shall request through \_\_\_\_\_."

If the report has been furnished to the Office of Technical Services, Department of Commerce, for sale to the public, indicate this fact and enter the price, if known.

11. **SUPPLEMENTARY NOTES:** Use for additional explanatory notes.

12. **SPONSORING MILITARY ACTIVITY:** Enter the name of the departmental project office or laboratory sponsoring (*paying for*) the research and development. Include address.

13. **ABSTRACT:** Enter an abstract giving a brief and factual summary of the document indicative of the report, even though it may also appear elsewhere in the body of the technical report. If additional space is required, a continuation sheet shall be attached.

It is highly desirable that the abstract of classified reports be unclassified. Each paragraph of the abstract shall end with an indication of the military security classification of the information in the paragraph, represented as (TS), (S), (C), or (U).

There is no limitation on the length of the abstract. However, the suggested length is from 150 to 225 words.

14. **KEY WORDS:** Key words are technically meaningful terms or short phrases that characterize a report and may be used as index entries for cataloging the report. Key words must be selected so that no security classification is required. Identifiers, such as equipment model designation, trade name, military project code name, geographic location, may be used as key words but will be followed by an indication of technical context. The assignment of links, rules, and weights is optional.